

LEAKAGE ACCEPTANCE RATES COMPARISON METAL & SOFT SEATED VALVES ISO 5208/API 598/API 6D/MSS SP-61/FCI 70-2

TESTING & LEAKAGE RATES OVERVIEW

From an engineering point of view, almost all valves leak by some measure. Valves may be said to be 'bubble tight' or 'zero leakage', but in actuality that is just a term that specifies the allowable leakage of that classification. From an engineering viewpoint there is no such thing as true zero leakage. Triple and quadruple offset butterfly valve manufacturers differentiate their product by claiming this style of valve actually is zero leakage. Bear in mind even solid glass 'leaks' 1cc every 3 years per square cm! Did you know, API 6D/API 598/ISO 5208 do not always require a high pressure **and** a low pressure seat test to be done as a mandatory requirements for all valves types? Depending on size, type and class only either a high or a low pressure test but not both. Global Supply Line enforces all our manufacturers perform both testes.

In the past many products were rated with Cold Working Pressure [CWP] [i.e. 800 psi WOG which meant 800 psi working pressure for water, oil or gas service], instead of the ASME/ANSI pressure classes used today for most steel valves. Of course many 'commodity', low pressure screwed end valves up to 2000 psi are still produced in CWP WOG ratings.

The base test specification for most steel valves is API 598 'Valve Inspection & Test'. Most metallic seated valves larger than ANSI 50 NB [2"] size have an allowable leakage rate shown in API 598 and ISO 5208. Soft seated valves such as ball valves must be zero leakage. Bronze gate, globe & check valves are usually only tested per MSS SP-61 'Pressure Testing of Steel Valves'.

'Pipeline Valves' such as trunnion mounted ball valves, pressure balanced lubricated plug valves and pipeline slab gate valves are tested to API 6D - 'Pipeline Valves'. API 6D now references ISO 5208 leakage rates. The testing requirements differ slightly from API 598 [ISO 5208 is now mirrored to API 598]. The primary difference being 6D's focus on valves with zero allowable leakage on closure [seating] tests which is achieved as most of the valves built to API 6D are resilient seated. Of course metal seated valves are also accommodated as API 6D references ISO 5208 leakage rates. However, metal seated API 6D and API 594 check valves do have a seat leakage allowance. API 598/ISO 5208 does incorporate a zero leakage requirement for soft seated valves used in refineries and downstream but API 6D is generally specified for pipeline valves.

Conventional metal seated API midstream and down stream valves allow varying degrees of seat leakage. API 598/ISO 5208. Examples of common ASME/ANSI valves used by Petroleum, Petrochemical & allied industries are:

- API 608 Floating Ball Valves
- API 600/API 603 Gate Valves
- API 623/ASME B16.34 Globe Valves [formerly BS1873]
- API 594/API 6D/ASME B16.34 Swing Check Valves [formerly BS 1868]
- API 594 Wafer Check Valves

EXPLANATION OF ZERO AND LOW LEAKAGE TEST STANDARDS

In general, specification such as API 598 [mirrored with ISO 5208] or API 6D [ISO 5208 leakage rates] that govern leakage for soft seated valves call for '0' bubbles of air or '0' drops of water under the specified test conditions over the minimum test time period. These valves are therefore sometimes referred to as 'zero leakage' valves. In reality, there really is no such thing as 'zero leakage', since microscopic amounts of material may indeed cross the seat or packing boundaries, especially if helium or hydrogen or other small molecule gases are used. Another common term for soft seated valves is 'bubble tight'.

Less frequently, the leakage performance for soft seated valves is referred to as Class VI [EN 60534-4], which is the tightest leakage under FCI 70-2, and generally applies to resilient seated control valves [as opposed to metal seated control valves or soft seated shut off valves]. In fact, FCI 70-2 Class VI [EN 60534-4] [formerly ANSI B16.104] allows a small number of bubbles and drips per minute, increasing with valve size, during the test, whereas API 598 does not

[for soft seat, but does for metal seat]. FCI 70-2 Class VI [EN 60534-4] is for soft seated control valves but is frequently used as a leakage acceptance test criteria for metal seated isolation valves such as ball and butterfly valves. FCI 70-2 only requires a low pressure test, consequently closure and seat tests should also be done per API 598 [ISO 5208 leakage acceptance rates] or MSS SP-61. MSS SP-61 allows only 2.66 drops per minute per inch for isolation valves and is regarded as tight shut off for many types of industrial valves. It is superior to FCI 70-2 Class VI [EN 60534-4] [see Table 7].

In fact even for metal seat valves the API 598 leak acceptance criteria for metal seated valves [excluding check valves] allows less leakage than FCI 70-2 [ISA-S75.19] Class VI [EN 60534-4]. For zero leakage metal seated valves, API 6D [ISO 5208 Rate A] or API 598 soft seated zero leakage criteria can be specified [such as triple offset metal seated butterfly valves and some metal seated ball valves]. Special provisions for zero leakage gate valves can also be specified to BS 6755 [now EN 12266-1] and ISO 5208 under special zero leakage classes. However, metal seated valves usually have some level of acceptable leakage when tested, defined first as some acceptable amount of liquid, under test conditions and over the time period of the test. Knife gate valves refer to MSS SP-81/MSS SP-151 leakage rates for metal seated [for resilient seat refer to MSS SP-61 or the manufacturer or client will nominate leakage].

ISO 5208 [EN 12266-1] supersedes BS 6755-1 and specifies acceptable leakage rates such as 'Rate A' and 'Rate B'. Rate A allows 'no visible leakage', similar to API 598 for resilient seated valves. API 6D now references leakage rates in ISO 5208 which in turn corresponds to leakage rates in EN 12266-1 [but only for class A, B, C, D, E, F & G].

COMMON VALVE TYPES & RELATED TEST STANDARDS

Valve type	Common test standard
Steel ball, gate, globe and check valves	API 598/ ISO 5208
Steel ball, gate, globe and check valves	BS 6755*, ISO 5208 [EN 12266-1]
Cast Iron gate valves	API 598/ ISO 5208, MSS SP-70
Bronze gate, globe and check valves	MSS SP-80
Steel gate, globe and check valves larger than NPS 24"	ASME B16.34
Pressure seal gate, globe and check valves	ASME B16.34
Pipeline valves	API 6D/ ISO 14313, ISO 5208
Cast iron checks	API 598/ ISO 5208, MSS SP-71
Cast iron globes	API 598/ ISO 5208, MSS SP-85
Cast iron plugs	API 598/ ISO 5208, MSS SP-78
Steel ball valves	API 598/ ISO 5208
Steel butterfly valves	API 598/ ISO 5208
Cryogenic valves	API 598/ ISO 5208, BS 6364
Control valves	FCI 70-2, ISA-S75
Pressure relief valves	API 527, ASME PTC 25

* ISO 5208 [EN 12266-1] supersedes BS 6755.

ANSI/FCI 70-2-2005 VALVE LEAKAGE CLASSIFICATIONS

[Supersedes ANSI B16.104]

- Class I.** Identical to Class II, III, and IV in construction and design intent, but no actual shop test is made.
- Class II.** Intended for double-port or balanced single-port valves with a metal piston ring seal and metal-to-metal seats. Air or water at 45 to 60 psig is the test fluid. Allowable leakage is 0.5% of the rated full open capacity.
- Class III.** Intended for the same type of valves as in Class II. Allowable leakage is limited to 0.1% of rated valve capacity.
- Class IV.** Intended for single-port and balanced single-port valves with extra-tight piston seals and metal-to-metal seats. Leakage rate is limited to 0.01% of rated valve capacity [known as metal to metal]. Test fluid is air or water, pressure 45 and 50 psig or the operating pressure if lower.
- Class V.** Intended for the same types of valves as Class IV. The test fluid is water at 100 psig or operating pressure. Leakage allowed is limited to 5×10^{-4} ml [= .0005ml] per minute per inch of orifice diameter per psi differential.
- Class VI.** Intended for resilient-seating valves. The test fluid is air or nitrogen. Pressure is the lesser of 50 psig or operating pressure. The leakage limit depends on valve size and range from 0.15 to 11.5 ml per minute for valve sizes 1 through to 12 inches [known as soft seat classification]. Class VI [EN60534-4] is also frequently used as a leakage bench mark for metal seated control and isolation valves where a tight degree of shut off is required.

There are six seat leakage classifications defined by ANSI/FCI 70-2 [supersedes ANSI B16.104]. The six valve Leakage classifications are as follows:

Table 1 - FCI 70-2 Leakage Rates Class VI [EN 60534-4]

Nominal Port Diameter [inches]	Allowable Leakage [ml Per Minute]	Allowable Leakage [Bubbles Per Minute]
1	0.15	1
1.5	0.30	2
2	0.45	3
2.5	0.60	4
3	0.90	6
4	1.70	11
6	4.00	27
8	6.75	45
10	9.00	63
12	11.5	81
14	21.6	
16	28.4	

Bubbles per minute is a suggested alternative to ml per minute; in which a 0.25 inch OD x 0.032 inch wall tube is submerged in water to a depth of 1/8" to 1/4". The tube is to be cut square and smooth with no imperfections and should be perpendicular to the surface of the water.

API 598 VALVE LEAKAGE RATES

API 598 [also mirrored by ISO 5208] from the American Petroleum Institute also covers testing/inspection requirements for gate, globe, check, ball, plug and butterfly valves. API 598 indicates that for shell and backseat tests [backseat only applies in the case of gate & globe valves], no visible leakage is permitted through body, body liner or joints; i.e. no visible evidence of drops or wetting of the external surfaces. In the case of 'metal to metal' butterfly valves, the client can specify the acceptable leakage rate. API 598 nominates a low pressure seat test of 80 psi and a high pressure seat* hydrostatic test of 1.1x the maximum valve cold working pressure rating and a high pressure hydrostatic test of 1.5 x the maximum valve cold working pressure rating.

* The requirements on the body for seat testing under API 598 do vary according to valve type, size & class. For instance trunnion valves 150 NB [6"] and over seat testing requirements are more stringent. Refer to our technical data sheet on test pressures for API 598. Having said that API 6D/ISO 5208 is the required standard for trunnion ball valves.

API 598's allowable seat leakage rates are as follows:

Table 2 - API 598 [9th edition 2009] Valve Seat Leakage Rates

DN [mm]	NPS [in.]	All Resilient Seated Valves	All Metal-Seated Valves [except Check Valves]		Metal-Seated Check Valves	
			Liquid Test [drops/min.]	Gas Test [bubbles/min.]	Liquid Test [cc/min.]	Gas Test [m ³ /hr]
≤ 50	2	0	0 ^b	0 ^b	6	0.08
65	2 1/2	0	5	10	7.5	0.11
80	3	0	6	12	9	0.13
100	4	0	8	16	12	0.17
125	5	0	10	20	15	0.21
150	6	0	12	24	18	0.25
200	8	0	16	32	24	0.34
250	10	0	20	40	30	0.42
300	12	0	24	48	36	0.50
350	14	0	28	56	42	0.59
400	16	0	32	64	48	0.67
450	18	0	36	72	54	0.76
500	20	0	40	80	60	0.84
600	24	0	48	96	72	1.01
650	26	0	52	104	78	1.09
700	28	0	56	112	84	1.18
750	30	0	60	120	90	1.26
800	32	0	64	128	96	1.34
900	36	0	72	144	108	1.51
1000	40	0	80	160	120	1.68
1050	42	0	84	168	126	1.76
1200	48	0	96	192	144	2.02

a] 1 Milliliter and 1 cc is considered equivalent to 16 drops for the liquid test. b] There shall be no leakage for the minimum specified test duration. For liquid test, 0 drop means no visible leakage per minimum specified test duration. For gas test, 0 bubbles means less than 1 bubble per minimum specified test duration.



WARNING Even though leakage acceptance rates are shown under API 598 it is not mandatory to do high pressure hydrostatic seat test or a low pressure pneumatic seat test [see full details next page]. This must be specified at time of order. APV seat tests high and low pressure as standard but many manufacturers do not.

Table 3 - API598 Pressure Tests
 Valves: DN [NPS] ≤ DN 100 [NPS 4] and ASME Class ≤ 1500
 DN [NPS] > DN 100 [NPS 4] and ASME Class ≤ 600

Test Description	Valve Type					
	Gate	Globe	Plug	Check	Floating Ball	Butterfly and Trunnion Mounted Ball
shell	required	required	required	required	required	required
backseat ^a	required	required	NA	NA	NA	NA
low-pressure closure	required	optional ^c	required ^b	optional ^c	required	required
high-pressure closure ^d	optional ^{c f}	required ^e	optional ^{b c f}	required	optional ^{c f}	optional ^{c f}

NOTE NA = Not applicable.

^a The backseat test is required for all valves, except for bellows seals valves, that have the backseat feature.
^b For lubricated plug valves, the high-pressure closure test is mandatory and the low-pressure closure test is optional.
^c When the purchaser specifies an “option” test, the test shall be performed in addition to the required tests.
^d The high-pressure closure test of resilient-seated valves may degrade subsequent sealing performance in low-pressure service.
^e For power-operated and manually operated gear actuated globe valves, including non-return type globe valves, the high-pressure closure test shall be performed at 110% of the design differential pressure used for sizing of the operator.
^f A high-pressure closure test is required for all valves specified to be double block and bleed valves.

Table 4 - API598 Pressure Tests
 Valves: DN [NPS] ≤ DN 100 [NPS 4] and ASME Class ≤ 1500
 DN [NPS] > DN 100 [NPS 4] and ASME Class ≤ 600

Test Description	Valve Type					
	Gate	Globe	Plug	Check	Floating Ball	Butterfly and Trunnion Mounted Ball
shell	required	required	required	required	required	required
backseat ^a	required	required	NA	NA	NA	NA
low-pressure closure	optional ^b	optional ^b	optional ^b	optional ^b	required	required
high-pressure closure ^d	required	required ^d	required	required	optional ^{b c}	required

NOTE NA = Not applicable.

^a The backseat test is required for all valves, except for bellows seals valves, that have the backseat feature.
^b When an “optional” test is specified by the purchaser, the test shall be performed in addition to the required tests.
^d The high-pressure closure test of resilient-seated valves may degrade subsequent sealing performance in low-pressure service.
^e For power-operated and manually operated gear actuated globe valves, including non-return type globe valves, the high-pressure closure test shall be performed at 110% of the design differential pressure used for sizing of the operator.
^f A high-pressure closure test is required for all valves specified to be double block and bleed valves.

MSS VALVE LEAKAGE RATES

MSS SP-61-2009 Test Standards - This is the test standard that covers other below listed MSS valve standards. The Manufacturer’s Standardisation Society also has a section on valve leakage in Section 5 of their ‘Pressure Testing of Steel Valves - MSS SP-61-2009’. It covers on-off valves. Not control valves.

The following leakage rates are deemed acceptable by this testing standard:

For comparison purposes, the following are examples of leakage rates as noted in the MSS Specifications below:

- 10ml liquid = 2 teaspoons = 1/3 oz. = .001 litres
- 40ml liquid = 3 teaspoons = 1 1/2 oz. = .004 litres

METAL SEATED - GATE, GLOBE, BALL OR BUTTERFLY VALVES: 10 cc/hr per inch of nominal pipe diameter per hour. This equates to 2.66 drops/min/inch. For air test 1180 bubbles/min/inch is allowed. [e.g. A 6” globe valve is allowed to leak 60 cc/hr in a test]. Metal Seated knife gate valves to MSS SP-81 are not included, refer to MSS-SP151 [see below] which allows 40ml/min/inch at 40 psi [275 kPa]. All shut off or isolation valves specified to MSS-SP-61 must pass the above standards. The seat closure test must be performed at a fluid [liquid or gas] pressure no less than 1.1 times the 1000°F [380°C] rating rounded to the next 5 psi [0.5 bar].

The MSS SP-61 leakage rate is specified for resilient and metal seated check valves, however some manufacturers commonly specify a guaranteed maximum leakage for resilient seated check valves. For metal and resilient seated check valves the leakage rates referred to in MSS SP-81 for knife gate valves is often specified.

MSS SP-70 Cast Iron Gate Valves

The maximum permissible leakage rate on each seat shall be 10 milliliters per hour, per inch of diameter of nominal valve size.

[i.e. A 100NB [4"] Gate Valve can have a permissible leakage rate of up to 40 mL liquid per hour.]

MSS SP-71 Cast Iron Swing Check Valves

The maximum permissible leakage rate shall be 40 milliliters per hour per inch of diameter of nominal valve size.

[i.e. A 150NB [6"] Check Valve can have a permissible leakage rate of up to 240 mL liquid per hour.]

MSS SP-80 Bronze, Gate, Globe, Angle and Check Valves

The maximum permissible leakage rate for Gate, Globe and Angle Valves shall be 10 milliliters of water per hour per inch of diameter of nominal valve size.

The maximum permissible leakage rate for Check Valves shall be 40 milliliters of water per hour per inch of diameter of nominal valve size.

[i.e. A 50NB [2"] Gate Valve can have a permissible leakage rate of up to 20 mL liquid per hour.]

MSS SP-85 Cast Iron Globe and Angle Valves

The maximum permissible leakage rate on each seat shall be 10 milliliters per hour per inch of diameter of nominal valve size.

[i.e. A 200NB [8"] Globe Valve can have a permissible leakage rate of up to 80 mL liquid per hour.]

MSS SP-151 Knife Gate Valves [MSS SP-81]

Metal seated knife gate valves allow 40 milliliters per minute per inch [@ 275 kPa].

Soft seated knife gate valves must be specified, a commonly applied manufacturer acceptance level for smaller sizes in elastomer seat is 4 milliliters per minute per inch [@ 275 kPa].

API 6D/ISO 5208/EN 12266 VALVE LEAKAGE RATES

In the ISO 5208 Standard, account has been taken of the valve testing requirement needs of EN 12266 and API 598 with requirements referenced for PN designated valves for the former and Class designated valves for the latter.

There is a loosely defined correspondence between the leakage rate acceptance values of API 598 and the leakage Rate A as applied to DN ≤50, Rate AA-Gas and Rate CC-Liquid for other than metal seated check valves and for check valves: - Rate EE-Gas and Rate G-Liquid. Rates A, B, C, D, E, F and G correspond to values in EN 12266-1.

API 6D follows [see table 5] leakage rates specified in ISO 5208 covers pipeline valves. API 6D pipeline standards are a mirror/joint venture with ISO 14313 pipeline valve standards. ISO 5208 nominate several leakage rate levels [API 6D now refers to ISO 5208 leakage rates]. The most common being zero leakage 'Rate A' for soft seated ball valves, pipeline [6D style] gate valves and lubricated plug valves. Refer to table 5 for leakage rates. API 6D/ ISO 14313 require a high pressure hydraulic body test [body 1.5x, seat 1.1x maximum valve cold working pressure] and a low pressure pneumatic test on the seat. No body leakage is allowed per ISO 5208 during body test. High pressure gas tests are regarded as 'special tests'. ISO 5208 [EN 12266-1] supersedes BS 6755.

Table 5 - Maximum Allowable Closure Test Seat Leakage Rate ISO 5208:2008[E]/API 6D* [2008]

Test fluid	Unit leakage rates	Rate A	Rate AA	Rate B	Rate C	Rate CC	Rate D	Rate E	Rate EE	Rate F	Rate G
Liquid	mm ³ /s	No visually detectable leakage for the duration of the test	0,006 x DN	0,01 x DN	0,03 x DN	0,08 x DN	0,1 x DN	0,3 x DN	0,39 x DN	1 x DN	2 x DN
	drops/s		0,000 1 x DN	0,000 16 x DN	0,000 5 x DN	0,001 3 x DN	0,001 6 x DN	0,004 8 x DN	0,006 2 x DN	0,016 x DN	0,032 x DN
Gas	mm ³ /s	No visually detectable leakage for the duration of the test	0,18 x DN	0,3 x DN	3 x DN	22,3 x DN	30 x DN	300 x DN	470 x DN	3 000 x DN	6 000 x DN
	bubbles/s		0,003 x DN	0,0046 x DN	0,045 8 x DN	0,340 7 x DN	0,458 4 x DN	4,583 7 x DN	7,129 3 x DN	45,837 x DN	91,673 x DN

* API 6D - 2008 refers to ISO 5208 [2008-E] for leakage rates. EN 12266-1 also corresponds to ISO 5208 leakage rates but only for class A, B, C, D, E, F & G.

- NOTE 1 The leakage rates only apply when discharging test fluid to the atmosphere.
- NOTE 2 The closure leakage rate that applies is either that identified in a valve product standard or a leakage rate identified in a purchaser's valve procurement purchase order that is more stringent than that specified in the product standard.
- NOTE 3 The meaning of "No visually detectable leakage" is that there is no visible weeping or leakage in the form of drops or bubbles.
- NOTE 4 There is a loosely defined correspondence between the leakage rate acceptance values of API 598 and the leakage values Rate A as applied to DN < 50, Rate AA-Gas CC-Liquid for other than metal seated check valves and for check valves Rate EE-Gas and Rate G-Liquid. Rates A, B, C, D, E, F and G correspond to values in EN 12266-1.
- NOTE 5 Double block & bleed leakage test is optional only and the client can specify the allowable leakage past the first seat for larger sizes.
- NOTE 6 Valves tested in both directions.

Table 6 - Variations in Basic Test Parameters

Standard	Gas	Test water chlorides	Temperature
ASME B16.34	≥ 80 psi	NA	< 125 deg F
API 598	60 - 80 psi	≤ 100*	41 - 122 deg F
MSS SP-61	60 - 100 psi	NA	≤ 125 deg F
ISO 5208	6 bar +/- 1 bar [73 - 102 psi]	≤ 100*	≤ 5 deg C ≤ 40 deg C [41 - 106 deg F]
API 6D	NA	≤ 30** [by mass]	≤ 5 deg C ≤ 40 deg C [41 - 106 deg F]

* austenitic stainless steel valves
 ** wetted components austenitic & duplex stainless steels

Worlds largest valve stockist. Complete stock lists [click here](#). Stock includes ANSI 150 to 2500 class of ball, gate, globe, plug, and check valves in major brands, as well as scotch yoke, spring return, hydraulic and pneumatic actuators in JC, APV and other major brands. Shipping worldwide.

Table 7 - Common Isolation Valve Leakage Comparison API 598/ISO 17292/ API 6D/ISO 5208/ ANSI FCI 70-2/MSS SP-61/MSS SP-70/MSS SP-85/MSS SP-151/AS 2638.1

Valve Size		API 598 * Metal Seated Isolation Valve		API 598 Resilient seated	ISO 17292 [Ball Valve Metal Seat]	API 6D/ ISO 14313 Rate A ISO 5208 **** Zero Leakage	ISO 14323 Rate AA ISO 5208 **** Very Tight Shut Off		ISO 14323 Rate B ISO 5208 Tight Shut Off [per EN12266-1 9BS-EN1171 Gate]		ISO 14323 Rate C ISO 5208 Tight Shut Off		ISO 14323 Rate CC ISO 5208 Tight Shut Off		API 6D/ ISO 14313 Rate D ISO 5208 ***		ANSI FCI 70-2 [2006] Class VI [EN60534-4] ** [Based on seat diameter]		ANSI FCI 70-2 [2006] Class V [Based on seat diameter] [Control valves]			MSS SP-61 [& MSS SP-85 & MSS SP-70] [Isolation Valves] Metal Seated ****		AS 2638.1 Metal Seated Gate Valves	MSS SP-151 Metal Seated Knife Gate Valve
DN [mm]	NPS [Inch]	Liquid drops/ min.	Gas/ Air* bubbles/ min.	Liquid/ Air*	Liquid drops/ min.	Liquid/ Air*	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas Air bubbles*/ min.	Liquid	Example 285PSI Liquid drops/ min.	Example 720PSI drops/ min.	Liquid drops/ min.	Gas Air bubbles*/ min.	Liquid drops/ min.	Liquid drops/ min.
15	1/2	0	0		6		0.09	2.70	0.14	4.14	0.45	41.22	1.17	306.63	1.4	412.56	2.40	1		1.42	3.57	1.7	750		384
20	3/4	0	0		6		0.12	3.60	0.19	5.52	0.60	54.96	1.56	408.84	1.9	550.08	2.40	1		1.89	4.77	2.2	1000		512
25	1	0	0		6		0.15	4.50	0.24	6.9	0.75	68.70	1.95	511.05	2.4	687.60	2.40	1		2.36	5.96	2.8	1250		640
40	1-1/2	0	0		6		0.24	7.20	0.38	11.04	1.20	109.92	3.12	817.68	3.8	1100.16	4.80	2		3.77	9.53	4.4	2000		1024
50	2	0	0		6		0.30	9.00	0.48	13.8	1.50	137.40	3.90	1022.10	4.8	1375.20	7.20	3		4.72	11.92	5.5	2500		1280
65	2-1/2	5	10		6		0.39	11.70	0.62	17.94	1.95	178.62	5.07	1328.73	6.2	1787.76	9.60	4		6.13	15.49	7.2	3250		1664
80	3	6	12		12		0.48	14.40	0.77	22.08	2.40	219.84	6.24	1635.36	7.7	2200.32	14.40	6		7.55	19.06	8.8	4000	32	2048
100	4	8	16		12		0.60	18.00	0.96	27.6	3.00	274.80	7.80	2044.20	9.6	2750.40	27.20	11		9.44	23.83	11.0	5000	32	2560
150	6	12	24	No visually detectable leakage for the duration of the test	12	No visually detectable leakage for the duration of the test	0.90	27.00	1.44	41.4	4.50	412.20	11.70	3066.30	14.4	4125.60	64.00	27	5 x 10 ⁻⁴ ml per minute of water per inch of seat diameter per psi differential	14.16	35.75	16.5	7500	32	3840
200	8	16	32		24		1.20	36.00	1.92	55.2	6.00	549.60	15.60	4088.40	19.2	5500.80	108.00	45		18.87	47.66	22.0	10000	32	5120
250	10	20	40		24		1.50	45.00	2.40	69	7.50	687.00	19.50	5110.50	24.0	6876.00	177.60	63		23.59	59.58	27.5	12500	32	6400
300	12	24	48		24		1.80	54.00	2.88	82.8	9.00	824.40	23.40	6132.60	28.8	8251.20	256.00	81		28.31	71.49	33.0	15000	80	7680
350	14	28	56		30		2.10	63.00	3.36	96.6	10.50	961.80	27.30	7154.70	33.6	9626.40	345.60	-		33.03	83.41	38.5	17500	80	8960
400	16	32	64		30		2.40	72.00	3.84	110.4	12.00	1099.20	31.20	8176.80	38.4	11001.60	454.40	-		37.75	95.32	44.0	20000	80	10240
450	18	36	72		30		2.70	81.00	4.32	124.2	13.50	1236.60	35.10	9198.90	43.2	12376.80	-	-		42.47	107.24	49.5	22500	80	11520
500	20	40	80		30		3.00	90.00	4.80	138	15.00	1374.00	39.00	10221.00	48.0	13752.00	-	-		47.19	119.15	55.0	25000	80	12800
600	24	48	96		30		3.60	108.00	5.76	165.6	18.00	1648.80	46.80	12265.20	57.6	16502.40	-	-		56.62	142.98	66.0	30000	160	15360
750	30	60	120		-		4.50	135.00	7.20	207	22.50	2061.00	58.50	15331.50	72.0	20628.00	-	-		70.78	178.73	82.5	37500	160	19200
900	36	72	144	-	5.40	162.00	8.64	248.4	27.00	2473.20	70.20	18397.80	86.4	24753.60	-	-	84.93	214.47	99.0	45000	160	23040			
1000	40	80	160	-	6.00	180.00	9.60	276	30.00	2748.00	78.00	20442.00	96.0	27504.00	-	-	94.37	238.30	110.0	50000	160	25600			

API 6D corresponds to ISO 5208 - 2008 leakage rates, ISO 5208 in turn corresponds to EN 12266-1 leakage rates but only for class A, B, C, D, E, F & G

FCI 70-2 Class VI [EN60534-4] does not define leakage above 400 NB [16"]

FCI 70-2 Class VI [EN60534-4] test is performed always at 3 bar independently from the valve rating

[*] API 598 Seat Test for gate, plug, trunnion ball and butterfly valves the low-pressure or high-pressure seat test is a requirement, not both.

a low-pressure closure test is required for valves < 4" [Class ≤1500] and > 4" [Class ≤ 600]

a high-pressure closure test is optional for valves ≤ 4" [Class ≤ 1500] and > 4" [Class ≤ 600]

For globe & parallel slide valves, the low-pressure seat test is optional, but high-pressure test is mandatory.

For floating ball valves, the high-pressure seat test is optional, but the low-pressure seat test is mandatory.

For lubricated plug valves, the low-pressure closure test is optional, but the high-pressure closure test is mandatory.

All GSL manufacturers are required to perform high & low pressure seat tests on all the above valves.

[**] FCI 70-2 Class VI [EN60534-4] test is performed always at 3 bar independently from the valve rating.

[***] API 6D refers to ISO 5208 'Rate D' for metal seated leakage rates which also aligns with EN 12266-1. Rate 'AA' is shown above to compare the next highest level of shut off after rate A. See Table 5 above for all rates.

[****] API 6D refers to ISO 5208 [2008 - E] 'Rate A' for soft seated, zero leakage which aligns with EN 12266-1.


[*****] Resilient seated valves should have no visible leakage. [clause 5.7.3 MSS SP-61 2019].

Rough guide: - 1 ml = approximately 16 drops [as defined API 598] [note, drops per minute shown above for Rate D are from ISO 5208], 1 cc = approximately 25 bubbles, 1 cc = 1ml.

To provide some perspective here is an example of the time it would take to fill up a regular small size take away coffee cup.

Table 8 - Control Valve Seat Leakage vs. a Cup of Coffee

Liquid Test 100NB diameter seat	Leakage Rate ml/min	Time to fill small coffee cup
ISO 5208 Rate A	0	-
ISO 5208 Rate B	0.06	110 hours
ISO 5208 Rate C	0.18	36 hours
ISO 5208 Rate D	0.55	12.5 hours
ANSI/FCI 70-2 class V	0.60	11.5 hours

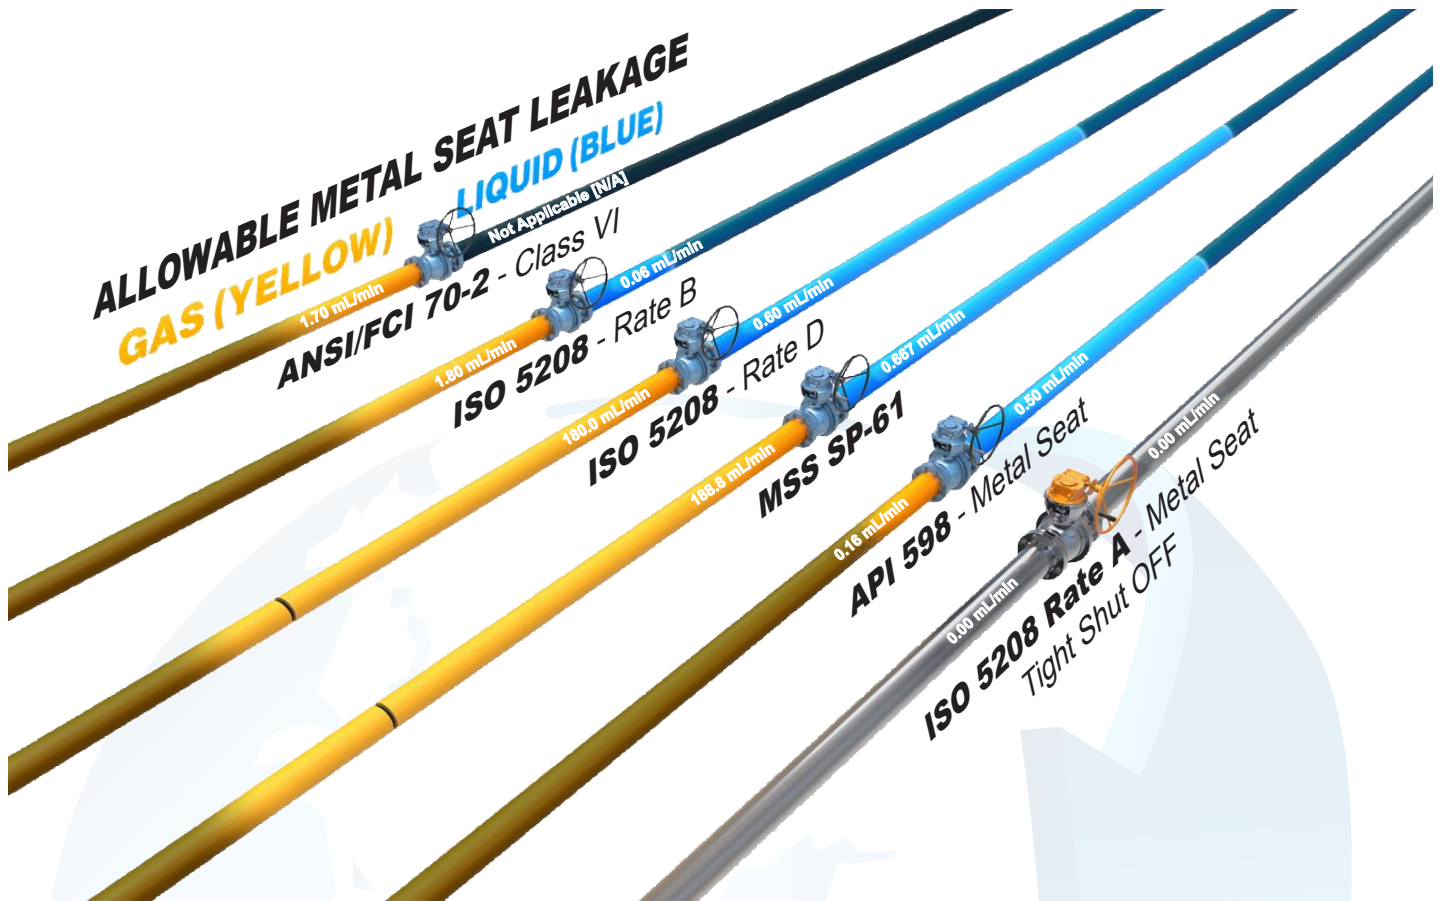

Global Supply Line specifies stringent leakage rate requirements.

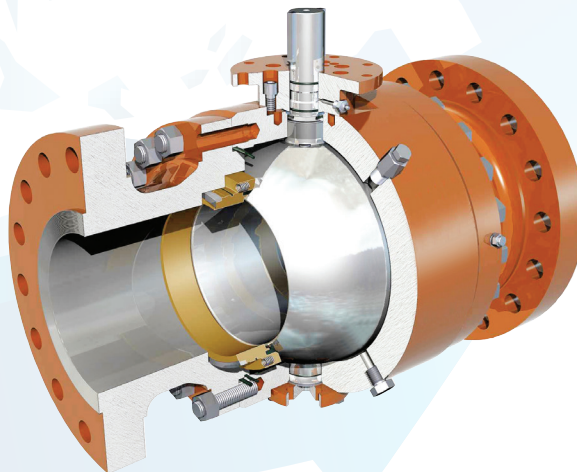


Table 9 - Metal Seated Check Valve Leakage Comparison Check Valves API 598/ISO 5208/FCI 70-2/MSS SP-71/AS/EN

Valve Size		API 598 * Metal Seated Check Valves		API 598 * Metal Seated Isolation Valve		API 598* Resilient seated valves [includes check valves]	Rate A ISO 5208 Tight Shut Off BS EN 16767 [was BS EN 12334] [resilient seat]	Rate AA ISO 5208 Very Tight Shut Off		Rate B ISO 5208 Tight Shut Off		Rate C ISO 5208 Tight Shut Off		Rate CC ISO 5208 Tight Shut Off		Rate D ISO 5208		Rate E ISO 5208		Rate EE ISO 5208		Rate F ISO 5208		Rate G ISO 5208/ [EN 12266-1] BS EN 16767 **** API 6D **		ANSI FCI 70-2 [2006] Class VI [EN60534-4] ***** [Based on seat diameter]		ANSI FCI 70-2 [2006] Class V [Based on seat diameter] [Control Valves]			MSS SP-71 [2006] Check Valves *** [metal seat]		AS 4794 Check Valves Resilient Seat	
DN [mm]	NPS [Inch]	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid/Air	Liquid drops/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Liquid	Example 285PSI Liquid drops/ min.	Example 720PSI drops/ min.	Liquid drops/ min.	Gas/ Air bubbles/ min.	Swing Check Liquid drops/ min.	Tilt Check Liquid drops/ min.		
15	1/2	96	133333	0	0			0.09	2.70	0.14	4.14	0.45	41	1.17	307	1.44	413	4.32	4125	5.58	6416	14.40	41253	29	82506			1.42	3.57	5.34	10000	32	8	
20	3/4	96	133333	0	0			0.12	3.60	0.19	5.52	0.60	55	1.56	409	1.92	550	5.76	5500	7.44	8555	19.20	55004	38	110008	2.40	1.00	1.89	4.77	8.00	15000	32	8	
25	1	96	133333	0	0			0.15	4.50	0.24	6.90	0.75	69	1.95	511	2.40	688	7.20	6876	9.30	10694	24.00	68756	48	137510			2.36	5.96	10.67	20000	32	8	
40	1-1/2	96	133333	0	0			0.24	7.20	0.38	11.04	1.20	110	3.12	818	3.84	1100	11.52	11001	14.88	17110	38.40	110009	77	220015	4.80	2.00	3.77	9.53	16.01	30000	32	8	
50	2	96	133333	0	0			0.30	9.00	0.48	13.80	1.50	137	3.90	1022	4.80	1375	14.40	13751	18.60	21388	48.00	137511	96	275019	7.20	3.00	4.72	11.92	21.34	40000	32	8	
65	2-1/2	120	183333	5	10			0.39	11.70	0.62	17.94	1.95	179	5.07	1329	6.24	1788	18.72	17876	24.18	27804	62.40	178764	125	357525	9.60	4.00	6.13	15.49	26.68	50000	32	8	
80	3	144	216666	6	12			0.48	14.40	0.77	22.08	2.40	220	6.24	1635	7.68	2200	23.04	22002	29.76	34221	76.80	220018	154	440030	14.40	6.00	0.07	0.18	32.01	60000	32	24-96	
100	4	192	283333	8	16			0.60	18.00	0.96	27.60	3.00	275	7.80	2044	9.60	2750	28.80	27502	37.20	42776	96.00	275022	192	550038	27.20	11.00	0.09	0.23	42.68	80000	32	32-96	
125	5	240	350000	-	-			0.75	22.50	1.20	34.50	3.75	344	9.75	2555	12.00	3438	36.00	34378	46.50	53470	120.00	343778	240	687548	64.00	27.00	0.11	0.29	53.35	100000	32	40-96	
150	6	288	416666	12	24	No visually detectable leakage for the duration of the test	No visually detectable leakage for the duration of the test	0.90	27.00	1.44	41.40	4.50	412	11.70	3066	14.40	4126	43.20	41253	55.80	64164	144.00	412533	288	825057	108.00	45.00	0.14	0.34	64.02	120000	32	48-96	
200	8	384	566666	16	32			1.20	36.00	1.92	55.20	6.00	550	15.60	4088	19.20	5501	57.60	55004	74.40	85552	192.00	550044	384	1100076	177.60	63.00	0.18	0.46	85.36	160000	32	64-96	
250	10	480	700,000	20	40			1.50	45.00	2.40	69.00	7.50	687	19.50	5111	24.00	6876	72.00	68756	93.00	106940	240.00	687555	480	1375095	256.00	81.00	0.23	0.57	106.70	200000	32	80-96	
300	12	576	833335	24	48			1.80	54.00	2.88	82.80	9.00	824	23.40	6133	28.80	8251	86.40	82507	111.60	128327	288.00	825066	576	1650114	345.60	-	0.27	0.69	128.04	240000	32	96	
350	14	672	983335	28	56			2.10	63.00	3.36	96.60	10.50	962	27.30	7155	33.60	9626	100.80	96258	130.20	149715	336.00	962577	672	1925133	454.40	-	0.32	0.80	149.38	280000	32	112	
400	16	768	1116669	32	64			2.40	72.00	3.84	110.40	12.00	1099	31.20	8177	38.40	11002	115.20	110009	148.80	171103	384.00	1100088	768	2200152	-	-	0.36	0.92	170.72	320000	80	128	
450	18	864	1266669	36	72			2.70	81.00	4.32	124.20	13.50	1237	35.10	9199	43.20	12377	129.60	123760	167.40	192491	432.00	1237599	864	2475171	-	-	0.41	1.03	192.06	360000	80	144	
500	20	960	1400002	40	80			3.00	90.00	4.80	138.00	15.00	1374	39.00	10221	48.00	13752	144.00	137511	186.00	213879	480.00	1375110	960	2750190	-	-	0.45	1.14	213.40	400000	80	160	
600	24	1152	1683336	48	96			3.60	108.00	5.76	165.60	18.00	1649	46.80	12265	57.60	16502	172.80	165013	223.20	256655	576.00	1650132	1152	3300228	-	-	0.54	1.37	256.08	480000	80	192	
750	26	1248	1816670	-	-			4.50	135.00	7.20	207.00	22.50	2061	58.50	15332	72.00	20628	216.00	206267	279.00	320819	720.00	2062665	1440	4125285	-	-	0.68	1.72	277.42	520000	160	208	
900	28	1344	1966670	-	-			5.40	162.00	8.64	248.40	27.00	2473	70.20	18398	86.40	24754	259.20	247520	334.80	384982	864.00	2475198	1728	4950342	-	-	0.82	2.06	298.76	560000	160	224	
1000	30	1440	2100004	60	120			6.00	180.00	9.60	276.00	30.00	2748	78.00	20442	96.00	27504	288.00	275022	372.00	427758	960.00	2750220	1920	5500380	-	-	0.91	2.29	320.10	600000	160	240	

API 6D specifies Rate 'G' for check valves. [Air test is optional] There is a correspondence between the leakage rate acceptance values of API 598 and ISO 5208 and the leakage values for metal seated check valves: Rate EE-Gas and Rate G-Liquid.

[*] API 598 seat low-pressure test is optional for all check valves, but high-pressure test is required.
 [**] API 6D & ISO 5208 [corresponds to EN 12266-1] specify leakage rate 'G' for Check Valves for liquid and Rate 'EE' for gas. API 6D/ISO 5208 air test optional for metal seated. API 6D & ISO 5208 do not specify a leakage rate for resilient seated check valves, hence the metal seated leakage rate is used unless client specifies otherwise.
 [***] MSS SP-61 clause 5.7.2 specifies a leakage allowance for metal seated check valves of 4 times the rate for isolation valves.
 [****] BS 5153 metal seated check valve was superceeded by BS EN 12334 which specified ISO 5208 [EN 12266-1] Rate G [metal seat] and Rate A for resilient seat. BS EN 16767 replaced BS EN 12334 and does not mandate a leakage rate hence Rate G for metal seat remains the manufacturers default. [Rate A for resilient seat].
 [*****] FCI 70-2 Class VI [EN60534-4] test is performed always at 3 bar independently from the valve rating.

Rough guide: - 1 ml = approximately 16 drops [as defined API 598] 1 cc = approximately 25 bubbles, 1 cc = 1 ml. For gas test 1 ml is equivalent to 100 bubbles.

Worlds largest valve stockist. Complete stock lists [click here](#). Stock includes ANSI 150 to 2500 class of ball, gate, globe, plug, and check valves in major brands, as well as scotch yoke, spring return, hydraulic and pneumatic actuators in JC, APV and other major brands. Shipping worldwide.